

Radon and Soil Gas Control Information Guide

The New 2024 Ontario Building Code effective January 1st, 2025 now requires the rough-in for a subfloor depressurization system along with measures to provide protection from radon and soil gas ingress into a new buildings.

Radon Gas Barrier Requirements:


- 1. walls (bituminous dampproofing), and OBC Reference: Sentence 9.13.4.2.(3), of Division B
- 2. Under the basement floor slab using 6 mil polyethylene lapped not less than 300 mm, and OBC Reference: Figures SB-9A or SB-9B of Supplementary Standard SB-9
- 3. Sealing along the perimeter of the basement floor slab and at all penetrations using flexible sealant (polyurethane caulking).

 OBC Reference: Clause 9.13.4.2.(4)(a), of Division B, and Supplementary Standard SB-9
- 4. Sump pump provided with a sealed cover designed to resist removal by children. OBC Reference 9.14.5.2. of Division B.

Note: Care must be taken when installing 6 mil polyethylene since it is prone to puncture. Please ensure the 6-mil polyethylene is adequately protected.


Sketch Drawings for Radon Gas Barrier.

Figure 1

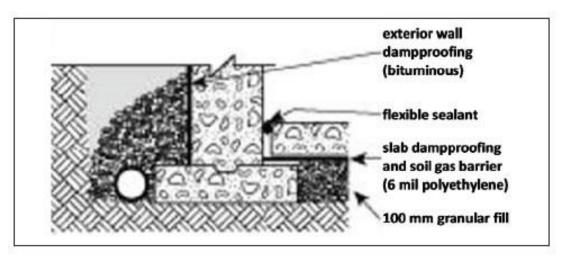

Solid Foundation Wall

Figure 2

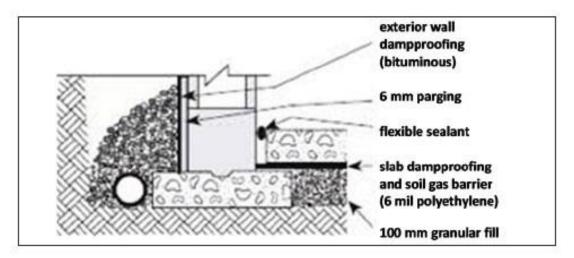

Hollow Foundation Wall

Subfloor Depression Rough-In Requirements:

- 1. A 100 mm diameter grey PVC pipe rough-in, *OBC Reference: Subsection* 3.2., Sentences (1) through (5) of Supplementary Standard SB-9
- 2. Minimum 150 mm granular material for a radius not less than 300 mm centered on the pipe, with the bottom of the pipe open to the granular,
- 3. The upper end of the pipe shall be provided with a removable sealed cap and labeled to indicate for "Radon Gas Removal Only".

Sketch Drawings for Subfloor Depression Rough-In

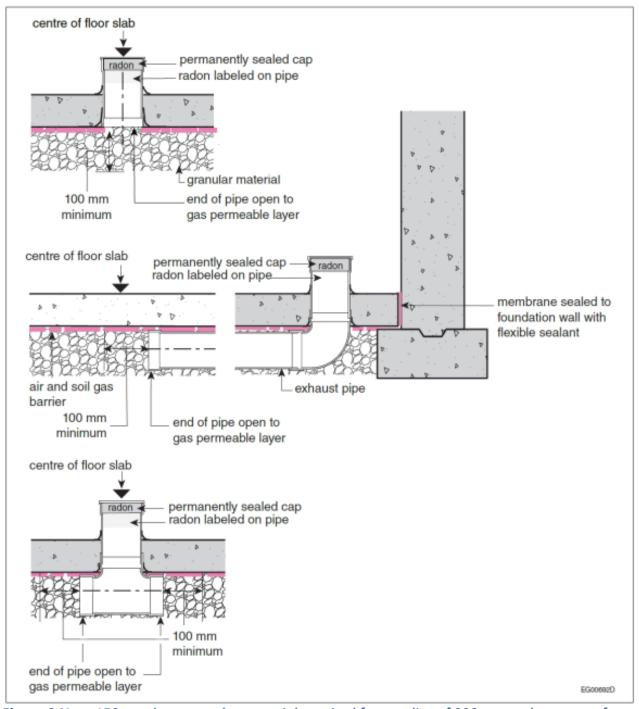


Figure 3 Note 150mm deep granular material required for a radius of 300mm at the centre of slab

Any Questions?

Phone: 705-428-6230 ext. 232 Web: www.clearview.ca

Office hours.

Monday to Friday 8:30am – 4:30pm